


air intake from
via high level

CC
FIRE BL
FIRE EX

PROPOSALS

CHANGE OF USE TO RESTAURANT 48 TOR

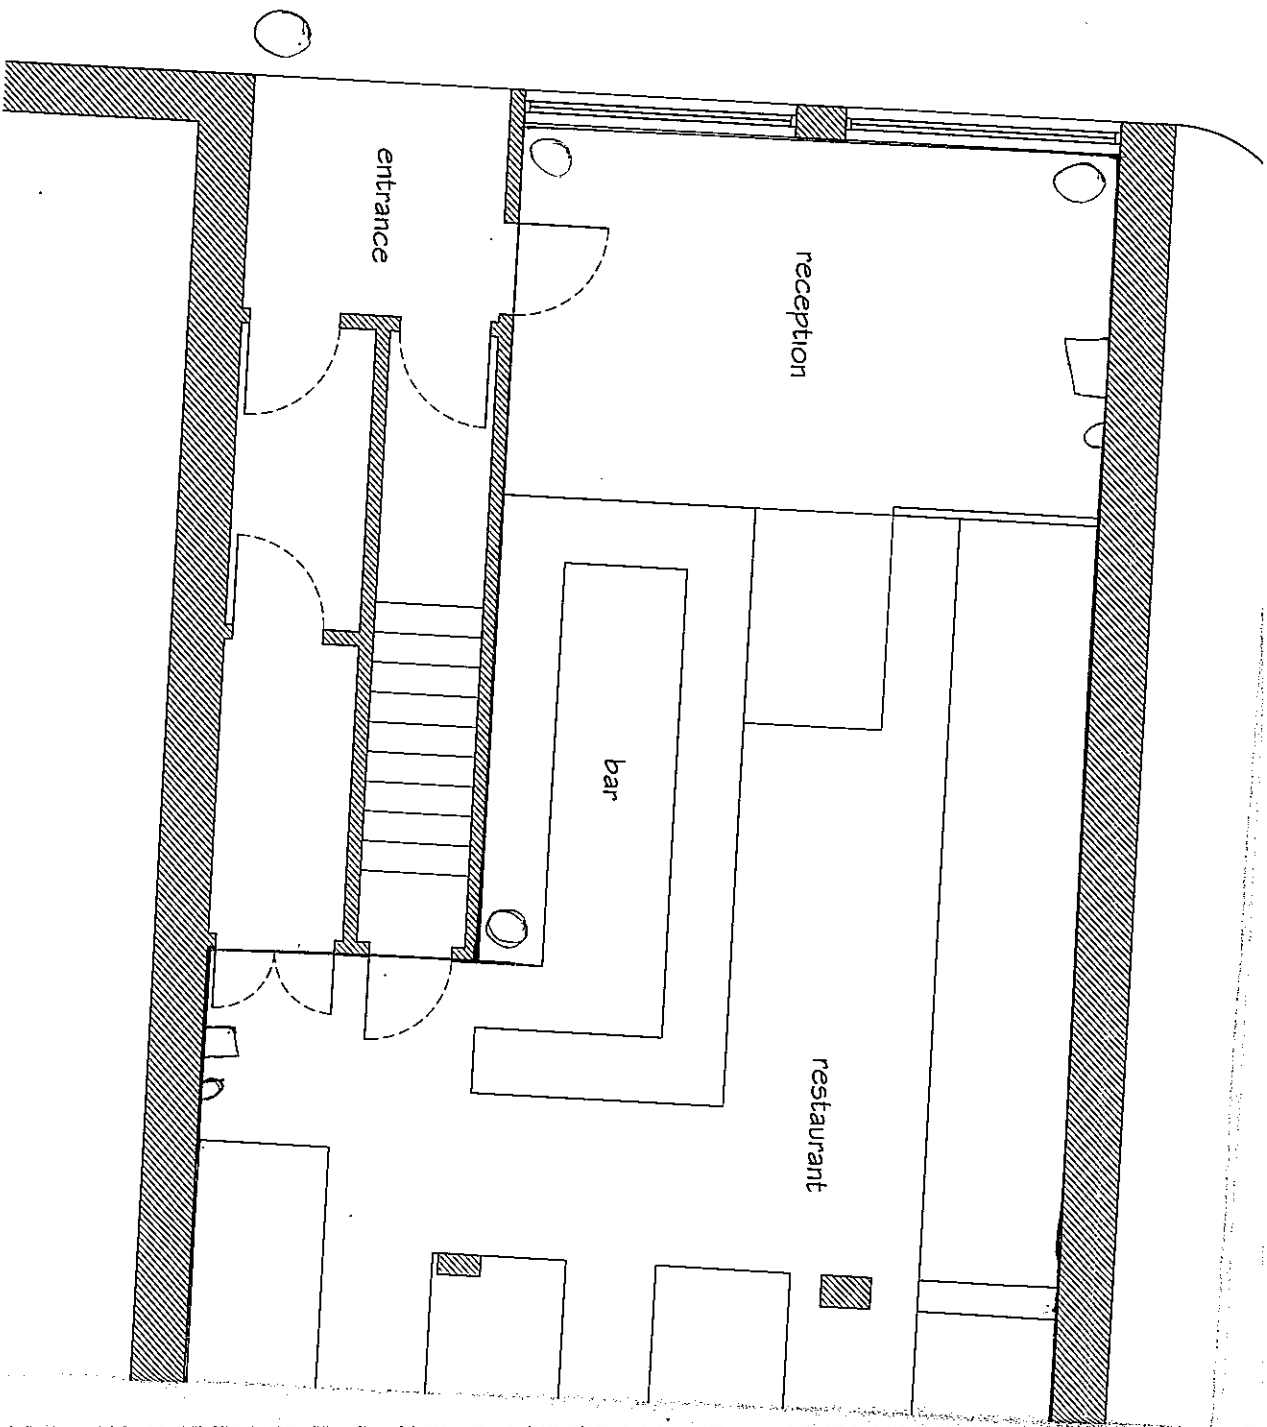

VENTILATION PR
PROPOSFN CHA