NOTE - Responsibility is not accepted for errors made by others in scaling from this drawing. All construction information should be taken from figured dimensions only.

METRES

0 1 2 3 4 5

SCALE: 1:50

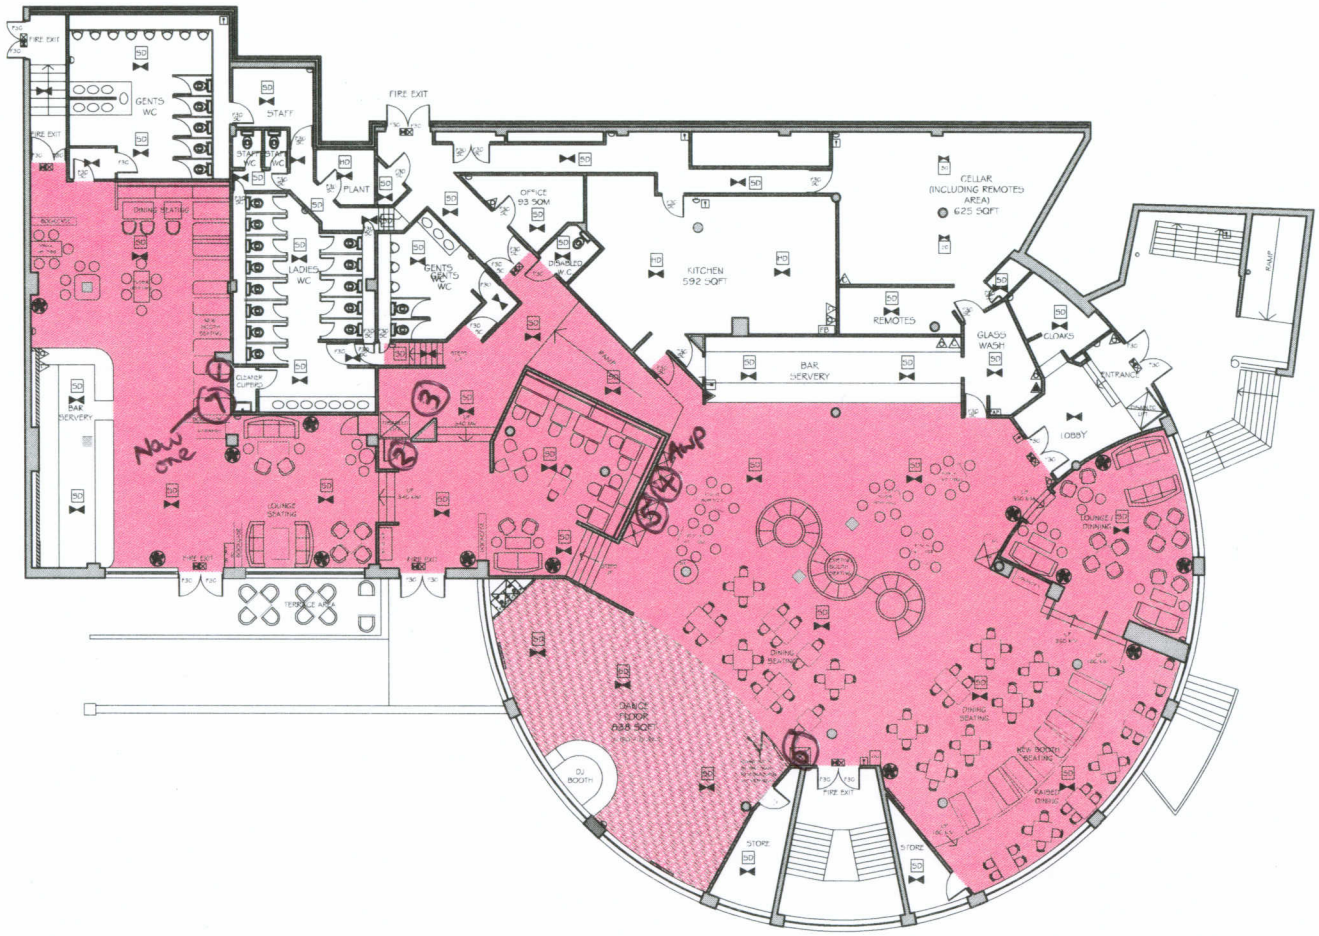

LEGEND

GROSS FLOOR AREAS:

GROUND FLOOR	11332 SQ FT / 1052 SQM
KITCHEN	592 SQFT / 55 SQM
CELLAR	625SQFT / 58 SQM
CUSTOMER AREA	5578 SQFT / 519 SQM
DANCE FLOOR	838 SQFT / 77 SQM

F20	TWENTY MINS FIRE RESISTANT WITH SMOKE SEALS AND INTUMESCENT STRIP
F30	HALF HOUR FIRE RESISTANT WITH SMOKE SEALS AND INTUMESCENT STRIP
F60	ONE HOUR FIRE RESISTANT WITH SMOKE SEALS AND INTUMESCENT STRIP
VP	VISION PANEL
PP	PANIC PAD
PB	PANIC BAR
SC	SELF CLOSING
SCA	SELF CLOSING AUTOMATIC RELEASE
FL	FUSIBLE LINK
DS	DOOR SELECTOR
	ILLUMINATED EMERGENCY FITTING WITH RUNNING PERSON SYMBOL+ARROW
	NON MAINTAINED EMERGENCY FLOODLIGHTING C/W BATTERY PACK

S13	FIRE DOOR KEEP SHUT 10mm LETTERS TO BOTH SIDES OF DOOR LEAF
S14	FIRE DOOR KEEP LOCKED 10mm LETTERS TO BOTH SIDES OF DOOR LEAF
S20	FIRE ESCAPE KEEP CLEAR 10mm LETTERS TO BOTH SIDES OF DOOR LEAF
S22	RUNNING PERSON SYMBOL+ARROW
S25	'PUSH BAR TO OPEN' 20mm LETTERS
S26	DIRECTIONAL ARROW (GREEN)
FRG	FIRE RESISTING GLAZING ELEMENT
	AREA COVERED BY ESCAPE LIGHTING TO BS 5266, PART 1
SD	AREA COVERED BY SMOKE DETECTOR
HD	AREA COVERED BY HEAT DETECTOR
	FIRE ALARM CALL POINT

FAP	FIRE ALARM CONTROL PANEL
	FIRE ALARM BELL /SOUNDER
C	CARBON DIOXIDE FIRE EXTINGUISHER
	9 LITRE WATER FIRE EXTINGUISHER
	DRY POWDER FIRE EXTINGUISHER
	FOAM FIRE EXTINGUISHER
WC	WET CHEMICAL FIRE EXTINGUISHER
FB	FIRE BLANKET

ALL WALLS AND PARTITIONS TO BE MINIMUM HALF HOUR FIRE RESISTANCE.

EMERGENCY LIGHTING TO COMPLY WITH 1988 EDITION OF BS 5266 PART 1.

FIRE SAFETY RELATED SIGNS AND NOTICES TO COMPLY WITH THE HEALTH AND SAFETY (SAFETY SIGN AND SIGNAL) REGULATIONS 1996

FIRE ALARM AND DETECTION SYSTEM TO BE INSTALLED TO BS 5839 PART 1 1988

FIRE FIGHTING EQUIPMENT TO COMPLY WITH BS 5306 WALL AND CEILING LININGS ARE TO BE CLASS 1 SURFACE SPREAD OF FLAME (AS DEFINED BY BS 476 PART 7) IN PUBLIC AREAS AND CLASS 0 IN ESCAPE ROUTES.

UPHOLSTERED SEAT FURNITURE TO SATISFY THE FOLLOWING

* IGNITION SOURCE (CIGARETTE TEST) AS SPECIFIED IN BS 5852 PART 1 FIRE TEST FOR FURNITURE METHODS OF TEST FOR THE IGNABILITY BY SMOKERS

* BS 5852 PART 2 FIRE TEST FOR FURNITURE METHODS OF TEST FOR THE IGNITABILITY OF UPHOLSTERED COMPOSITES FOR TESTING BY FLAMING SOURCE, MINIMUM TEST TO BE CRIB IGNITION SOURCE 5.

FABRICS THAT HAVE HAD A FLAME RETARDANT TREATMENT TO PASS THE WATER SOAK TEST AS DEFINED BY BS 5651 TEST CERTIFICATE TO BE SUBMITTED TO FIRE AUTHORITY.

CURTAINS AND DRAPES TO SATISFY TYPE B PERFORMANCE REQUIREMENTS TO BS 5867 PART 2.

ARTIFICIAL FOLIAGE AND DECORATIVE EFFECTS TO BE FIRE RETARDANT TO THE SATISFACTION OF THE FIRE AUTHORITY.

AREA FOR REGULATED ENTERTAINMENT/ SALE BY RETAIL OF ALCOHOL/ PROVISION OF LATE NIGHT REFRESHMENT

REV A: AWP LOCATIONS ALTERED 22.12.09 GB

K d paine & associates ltd
architectural & construction consultants
project managers interior designers
Active Business Centre Little High Street, Shoreham By Sea, West Sussex, BN43 5EG
t: +44 (0)1273 467518 f: +44 (0)1273 467520
e-mail: info@kdpaine.co.uk

CLIENT: JD WETHERSPOON PLC

PROJECT: PUB NO: 6011
THE WILLIAM KITSON
TORQUAY

DRAWING: PROPOSED GROUND FLOOR LICENSING PLAN.

SCALE	DATE	DRAWN
1:100@ A1	SEP 2009	AJH / GB
PROJECT No.	DRAWING No.	REVISION
6011	L-04	A